


BIS M-407 Ethernet with TCP/IP-Protocol

Quick Guide

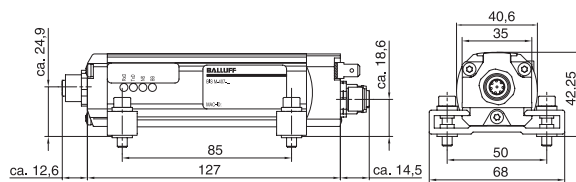

www.balluff.com

1	User Notes	4
1.1	About this Manual	4
1.2	Manual layout	4
1.3	Conventions	4
1.4	Symbols	4
1.5	Abbreviations	4
2	Safety	5
2.1	Intended use	5
2.2	General notes on device safety	5
2.3	Meaning of safety instructions	5
3	Getting Started	6
3.1	Mechanical connection	6
3.2	Electrical connection	6
3.3	Bus connection	7
4	Basic Knowledge	8
4.1	Identification system principles of operation	8
4.2	Product description	8
4.3	Communication module	8
4.4	Bus connection	9
5	Technical Data	10
5.1	Dimensions	10
5.2	Mechanical Data	10
5.3	Electrical Data	10
5.4	Operating conditions	10
5.5	Function indicators	11
	Appendix	12

1 User Notes

1.1 About this Manual

This manual describes the processor for the BIS M-407 identification system and guides you through startup for immediate operation.



Note

A detailed user's guide for the processor can be found on the accompanying BIS-CD or in the Internet under www.balluff.com.

1.2 Manual layout

The manual is designed so that each section builds on the previous sections.

Section 2: Basic information regarding safety.

Section 3: The main steps in installing the identification system.

Section 4: Basic informations for using the product.

Section 5: Technical data for the processor.

1.3 Conventions

The following conventions are used in this manual.

Enumerations

Enumerations are represented as a list with bullet points.

- Entry 1,
- Entry 2.

Actions

Action instructions are indicated by a preceding triangle. The result of an action is indicated by an arrow.

- ▶ Action instruction 1.
⇒ Result of action.
- ▶ Action instruction 2.

Notation

Numbers:

- Decimal numbers are represented without additional description (e.g. 123),
- hexadecimal numbers are represented by appending the abbreviation `hex` (e.g. `00hex`).

Directory paths:

Paths in which data are or will be saved/stored are represented in small caps (e.g. `PROJECT:\DATA TYPES\USERDEFINED`).

Cross-references

Cross-references indicate where additional information on the topic can be found ([see "Technical Data" on page 10](#)).

1.4 Symbols



Attention!

This symbol indicates a safety advisory which must be observed.



Note, tip

This symbol indicates general notes.

1.5 Abbreviations

BIS	Balluff Identification System
CRC	Cyclic Redundancy Code
EEPROM	Electrical Erasable and Programmable ROM
EMC	Electromagnetic Compatibility
IP	Internet Protocol
MAC-ID	Media Access Control Identifier
PC	Personal Computer
PLC	Programmable Logic Controller
TCP	Transmission Control Protocol

2

Safety

2.1 Intended use

The BIS M-407 processor is a component of the BIS M identification system. Within the identification system it is used for linking to a host computer (PLC, PC). It is intended only for use only in this way and in an industrial environment complying with Class A of the EMC Law.
This description applies to processors in series BIS M-407-039-....

2.2 General notes on device safety

Installation and startup

Installation and startup are to be carried out only by trained specialists. The manufacturer revokes the right to any warranty or liability claims resulting from unauthorized modifications or improper use. When connecting the processor to an external controller, be sure to observe proper polarity for all connections including the power supply (see section "Getting Started" on page 7).

The processor must be operated only using approved power supplies (see section "Technical Data" on page 10).

Operation and testing

It is the responsibility of the operator to ensure that the locally applicable safety regulations are maintained.

In case of defects and faults in the identification system which cannot be remedied, take it out of operation and protect against unauthorized use.

2.3 Meaning of safety instructions



Attention!

The pictogram used with the word "Attention" warns of a possibly hazardous situation for the health of persons or equipment damage.

Disregarding these warnings may result in personal injury or equipment damage.

- Always observe the instructions given for avoiding this hazard.

3 Getting Started

3.1 Mechanical connection

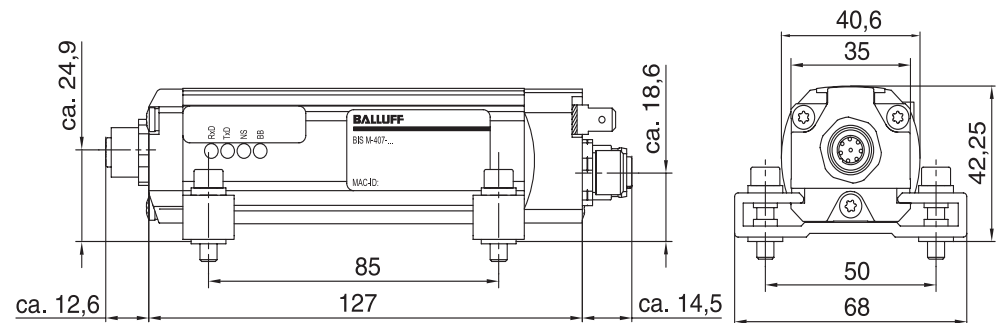


Fig. 1: Dimensions in mm

- Attach processor using (4) M4 screws.

3.2 Electrical connection



Note

Route the ground wire to ground either directly or through an RC combination, depending on the system.

When connecting to the Ethernet, be sure that the connector shield is perfectly connected to the connector body.


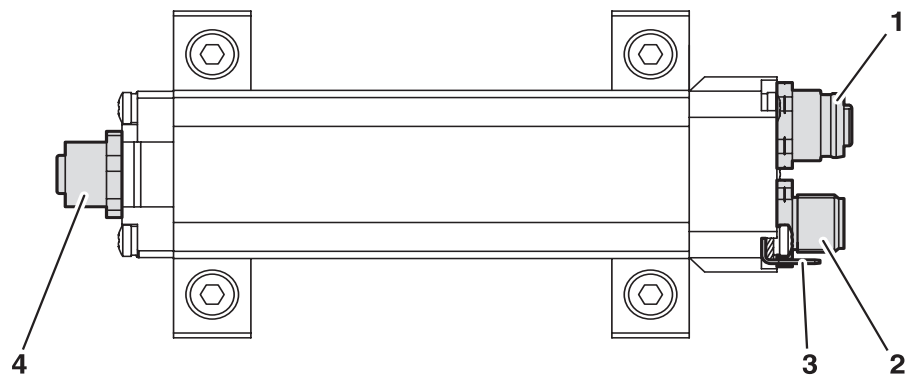


Fig. 2: Electrical connection

- 1 X3 - Ethernet
- 2 X1 - Power supply

- 3 Function Ground - FE
- 4 Head - Read/write head


Getting Started

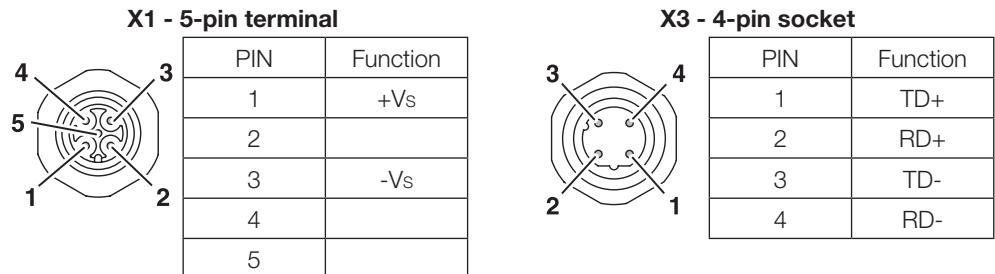

The bus connection is established using the "BIS SetIP" program running on a Windows PC having an Ethernet connection. The "BIS SetIP" application is included on the BIS-CD supplied.

3.3 Bus connection

- ▶ Start "BIS SetIP".
- ⇒ The "BIS_-6027 assign IP Address" window is opened.

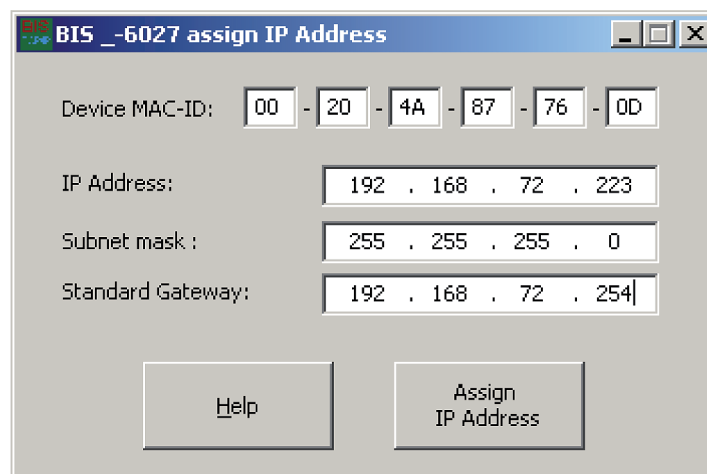

- ▶ Enter the MAC-ID for the device.



Note

The MAC-ID for the device can be found on the sticker on the housing cover.

- ▶ Assign IP address, subnet mask and gateway address.
- ▶ Confirm your setting by clicking on "Assign IP Address".

4 Basic Knowledge

4.1 Identification system principles of operation

The BIS M identification system belongs to the category of non-contact systems having a read and write function. This enables you to not only read data contained in the data carriers, but also to write new data to them at any point in the process.

The main components of the BIS M identification system are:

- Processor,
- Read/write heads,
- Data carriers.

The main areas of application are:

- In production for controlling material flow (e.g. for variant-specific processes, workpiece transport using conveying systems, for collecting safety-related data),
- In inventory systems for monitoring inventory movements,
- In transport and conveying technology.

4.2 Product description

BIS M-407 processor:

- Metal enclosure,
- Round connectors for making plug connections,
- Capacity for one read/write head,
- Read/write heads are suitable for both dynamic and static operation,
- Processor provides power for system components,
- Carrier signal from the read/write heads provides power for the data carrier.

4.3 Communication module

The communication module is used for implementing data exchange between the processor and the host system. The LED on the communication module indicates the status of the Ethernet connection.

LED indicator

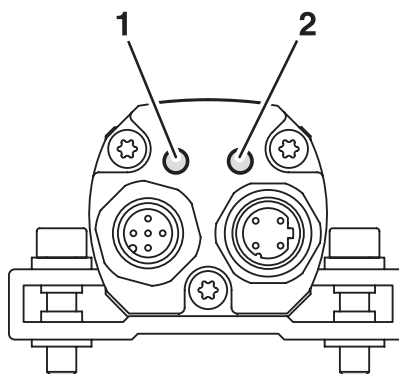


Fig 3: LED indicator on communication module

- 1 LED 1
- 2 LED 2

4 Basic Knowledge

LED 1 (10 BASE-T connection)	LED 2 (100 BASE-T connection)	Connection type
Off	Off	No connection
Off	Yellow	100 BASE-T half-duplex
Off	Flashing yellow	100 BASE-T half-duplex; activity
Off	Green	100 BASE-T full-duplex
Off	Flashing green	100 BASE-T full-duplex; activity
Yellow	Off	10 BASE-T half-duplex
Flashing yellow	Off	10 BASE-T half-duplex; activity
Green	Off	10 BASE-T full-duplex
Flashing green	Off	10 BASE-T full-duplex; activity

4.4 Bus connection

The processor and host system communicate using the physical Ethernet network. The device uses Internet Protocol (IP) for network communication. Transmission Control Protocol (TCP) is used to ensure complete, errorless and properly sequenced data transmission.

5 Technical Data

5.1 Dimensions

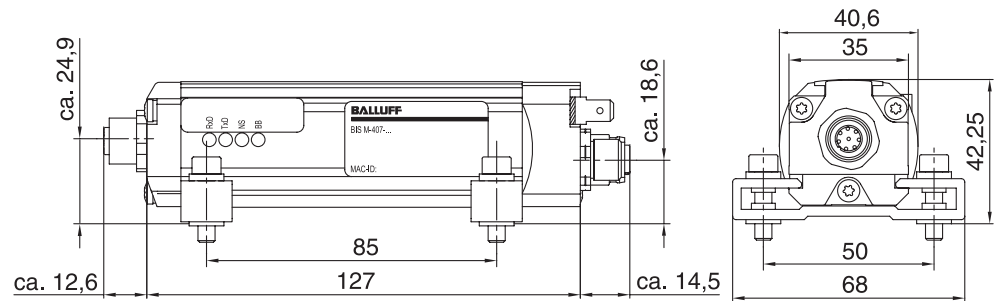


Fig. 4: Dimensions in mm

5.2 Mechanical Data

Housing material	EN AC-AISi12 (a), DIN EN 1706
X1 – Input	V _s 24V DC - 5-pin terminal
X3 – Ethernet	4-pin socket, D-coded
Head (Read/Write head connections)	8-pin socket
Enclosure rating	IP65 (with plugs connected)
Weight	950 g

5.3 Electrical Data

Operating voltage V _s	24V DC ±10 %
Ripple	≤ 10 %
Current consumption	≤ 400 mA
Device interface	Ethernet

5.4 Operating conditions

Ambient temperature	0 °C ... 60 °C
EMV	
– EN 61000-4-2/3/4/5/6	– Severity level 4A/3A/3A/1B/3A
– EN 55011	– Gr. 1, Cl. A
Shock/Vibration	EN 60068 Part 2-6/27/29/64/32

5 Technical Data

5.5 Function indicators

Overview of indicators

The operating states of the identification system, the Ethernet connection and the TCP/IP connection are indicated by means of LED's.

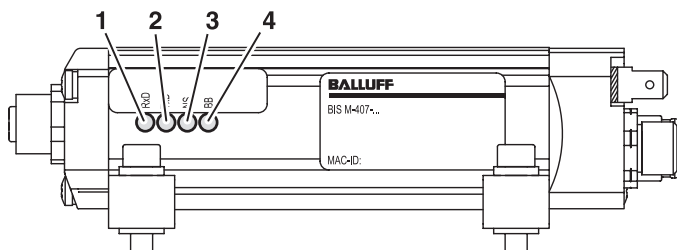


Fig. 5: Function indicators

- | | |
|------------------------------|------------------------------|
| 1 Receive Data (RxD) | 3 Network Status (NS) |
| 2 Transmit Data (TxD) | 4 Ready (BB) |

Power up

During power-up all LED's for the Ethernet connection are tested as described in the following table.

LED name	LED sequence							
Receive Data (RxD)	off							
Transwith Data (TxD)	off							
Network Status (NS)	on	off	1 x flash	off				
Ready (BB)	on	off	4 x flash	off	1 x flash	off	on	

Diagnostics

Status LED	Meaning
Receive Data	
off	No data transmission
yellow	Device receiving data
Transwith Data	
off	No data transmission
yellow	Device sending data
Network Status	
off	Device has no TCP/IP connection
green flashing	Device has a TCP/IP connection
Ready	
off	Network module defective. Inform service department
green	Network module is ready

Appendix

Ordering code

	BIS	M	-	407	-	039	-	003	-	06	-	S115
Balluff Identification system												
Series M Read/Write system												
Hardware-Type												
407 = Metal enclosure, Ethernet												
Software-Type												
039 = Ethernet with TCP/IP protocol												
Version												
003 = external Read/write head BIS M-3_ _												
Interface												
06 = Ethernet												
Customer connection												
M12 = 8-pin socket												

Accessories (optional, not included in scope of delivery)

Type

Ordering code

Read/write head		BIS M-30x-003-S115
Connector:		
no cable	for Head 1	BKS-S117-00
Connection cable:	for Head 1; 5 m	BIS S-501-PU1-05
one end with a straight, molded-in	for Head 1; 10 m	BIS S-501-PU1-10
connector (female),	for Head 1; 25 m	BIS S-501-PU1-25
one end for user-assembled connector,	for Head 1; 50 m	BIS S-501-PU1-50
length as desired		
Connection cable:	for Head 1; 5 m	BIS S-502-PU1-05
one end with a right-angle format,	for Head 1; 10 m	BIS S-502-PU1-10
molded-in connector (female),	for Head 1; 25 m	BIS S-502-PU1-25
one end for user-assembled connector,		
length as desired		
Connector	for X1	BKS-S 79-00
	for X3	BKS-S 182-00
Cover cap	for Head 1	Cover cap M12 female (121 671)
Adapter cable M12 D coded to RJ45		BIS C-526-PVC-00,5

 **www.balluff.com**

Balluff GmbH
Schurwaldstrasse 9
73765 Neuhausen a.d.F.
Germany
Phone +49 7158 173-0
Fax +49 7158 5010
balluff@balluff.de
 **www.balluff.com**